

WEATHERHEAD TO BE PROVIDED AND INSTALLED BY CUSTOMER. CUSTOMER TO HAVE NO LESS THAN 18" OF SERVICE WIRE OUT OF WEATHERHEAD FOR SERVICE CONNECTION MADE BY ELECTRIC DEPARTMENT. CONTACT ELECTRIC DEPARTMENT FOR CONDUIT HEIGHT REQUIREMENT AND TO COORDINATE INSTALLING RISER ON POLE.

STAND OFF BRACKETS PROVIDED BY ELECTRIC DEPARTMENT AND INSTALLED BY CUSTOMER. CONTACT ELECTRIC DEPARTMENT FOR SPECIFIC DETAILS ON SIZE AND LENGTH REQUIRED.

FIRST JOINT OF CONDUIT OUT OF GROUND MUST BE RIGID STEEL

NOTE 1: CUSTOMER SHALL OPEN AND BACKFILL DITCH


FINAL GRADE

DEPTH BY CODE

METER SOCKET PROVIDED BY ELECTRIC DEPARTMENT AND INSTALLED BY CUSTOMER. METER LOCATION MUST BE OBTAINED FROM ELECTRIC DEPARTMENT FOR ALL NEW SERVICES AND SERVICE UPGRADES.
 NOTE: GANG METER CENTERS NOT PROVIDED BY ELECTRIC DEPARTMENT

BUSHING PROVIDED AND INSTALLED BY CUSTOMER
 CUSTOMER TO FASTEN CONDUIT SECURELY TO BUILDING
 SLIP FITTING PROVIDED BY ELECTRIC DEPT AND INSTALLED BY CUSTOMER
 RIGID STEEL OR SCHEDULE 40 PVC CONDUIT AND SECONDARY CONDUCTORS PROVIDED AND INSTALLED BY CUSTOMER.

APPROX. 5'

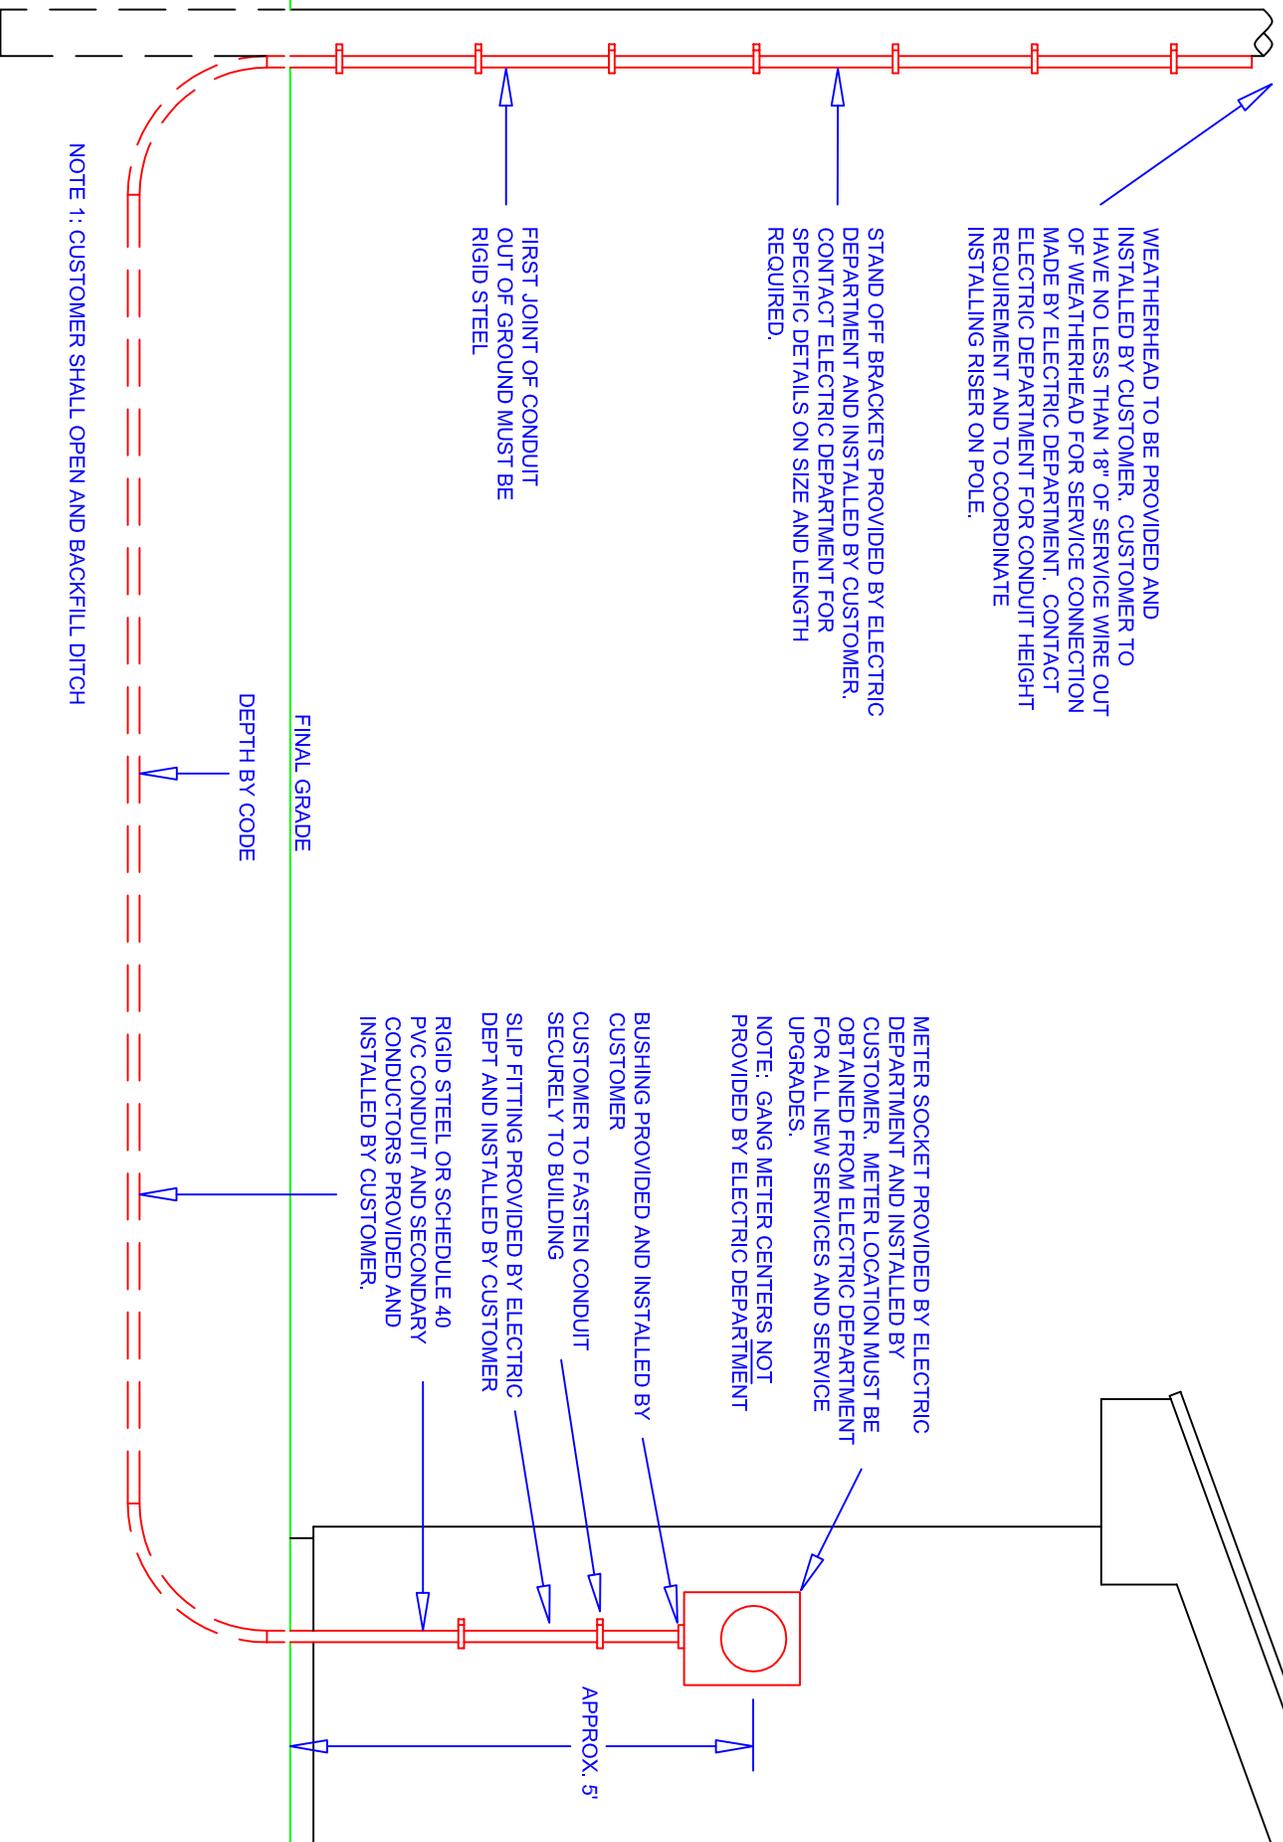

TYPICAL COMMERCIAL UNDERGROUND SERVICE, SINGLE OR GANG METER SOCKET, SINGLE PHASE- 600A OR SMALLER, OR THREE PHASE- 400 AMP SERVICE OR SMALLER

IMPORTANT NUMBERS:

ELECTRIC DEPARTMENT (540) 375-3030
 BUILDING INSPECTIONS (540) 375-3036
 UTILITY COLLECTIONS (540) 375-3021



City of Salem, VA
 Electric Department
 Service Standards