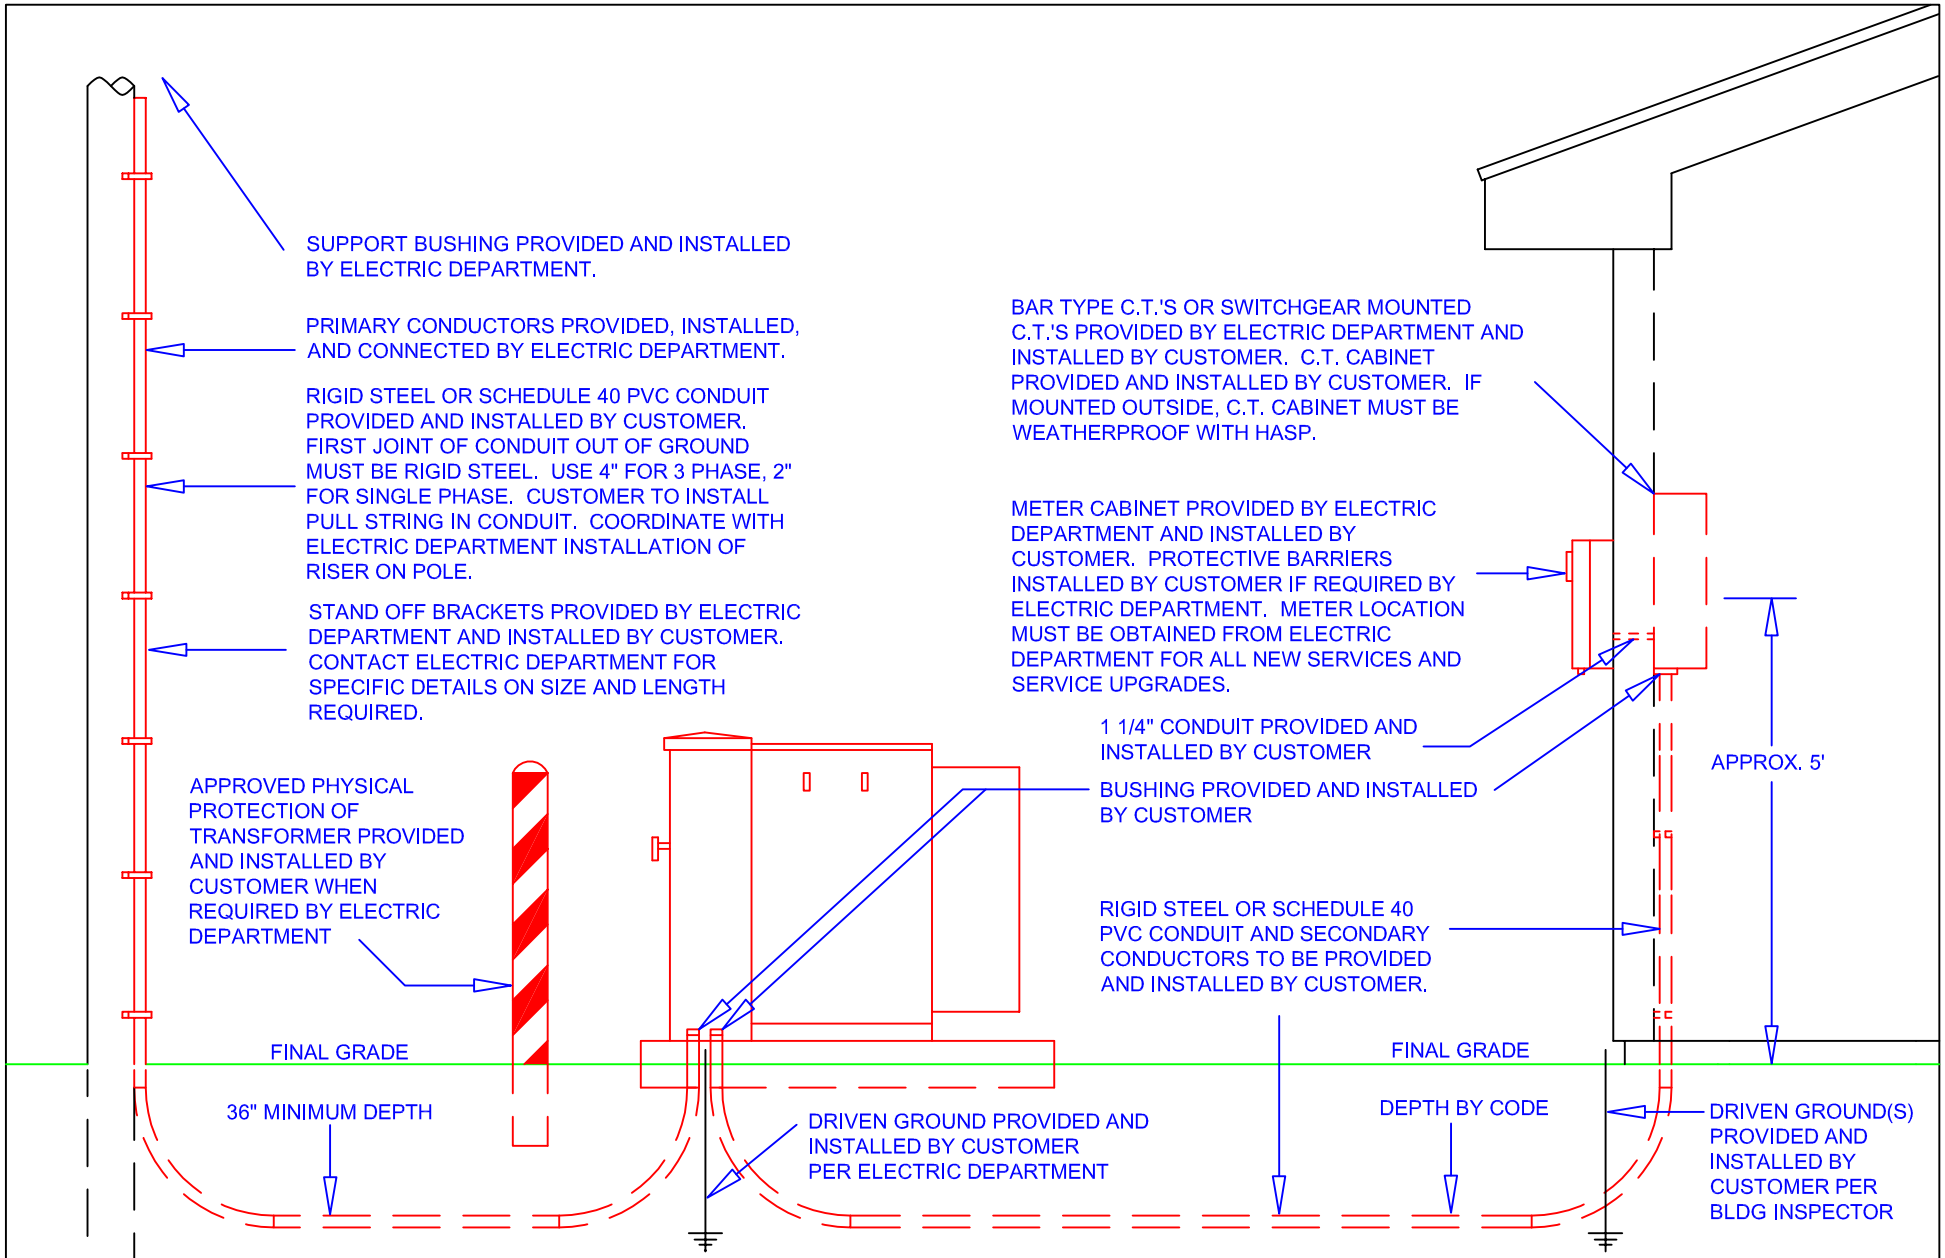

NOTE 1: CUSTOMER SHALL OPEN AND BACKFILL ALL DITCHES. ELECTRIC DEPARTMENT MUST INSPECT PRIMARY CONDUIT IN DITCH PRIOR TO BACKFILLING.

NOTE 2: TRANSFORMER FURNISHED AND INSTALLED BY ELECTRIC DEPARTMENT. TRANSFORMER PAD FURNISHED AND INSTALLED BY CUSTOMER TO ELECTRIC DEPARTMENT SPECIFICATIONS. PAD FORMS MUST BE INSPECTED BY ELECTRIC DEPARTMENT BEFORE POURING CONCRETE.

NOTE 3: CUSTOMER SHALL FURNISH ALL LUGS AND MAKE ALL CONNECTIONS IN C.T. CABINET AND IN SECONDARY COMPARTMENT OF TRANSFORMER.

COMMERCIAL UNDERGROUND SERVICE, SINGLE METER CABINET, SINGLE PHASE- SERVICES OVER 600 AMP, OR THREE PHASE- SERVICES OVER 400 AMP, TRANSFORMER ON PAD

IMPORTANT NUMBERS:

ELECTRIC DEPARTMENT	(540) 375-3030
BUILDING INSPECTIONS	(540) 375-3036
UTILITY COLLECTIONS	(540) 375-3021

City of Salem, VA
Electric Department
Service Standards

DRAWING 8 OF 8 REVISED 02/12