


NOTE: THIS INSTALLATION APPLIES TO ALL SINGLE AND MULTI-FAMILY DWELLING STRUCTURES AND ACCESSORY BUILDINGS, INCLUDING GARAGES. MAST HEIGHT REQUIREMENTS TO BE DETERMINED BY THE ELECTRIC DEPARTMENT.

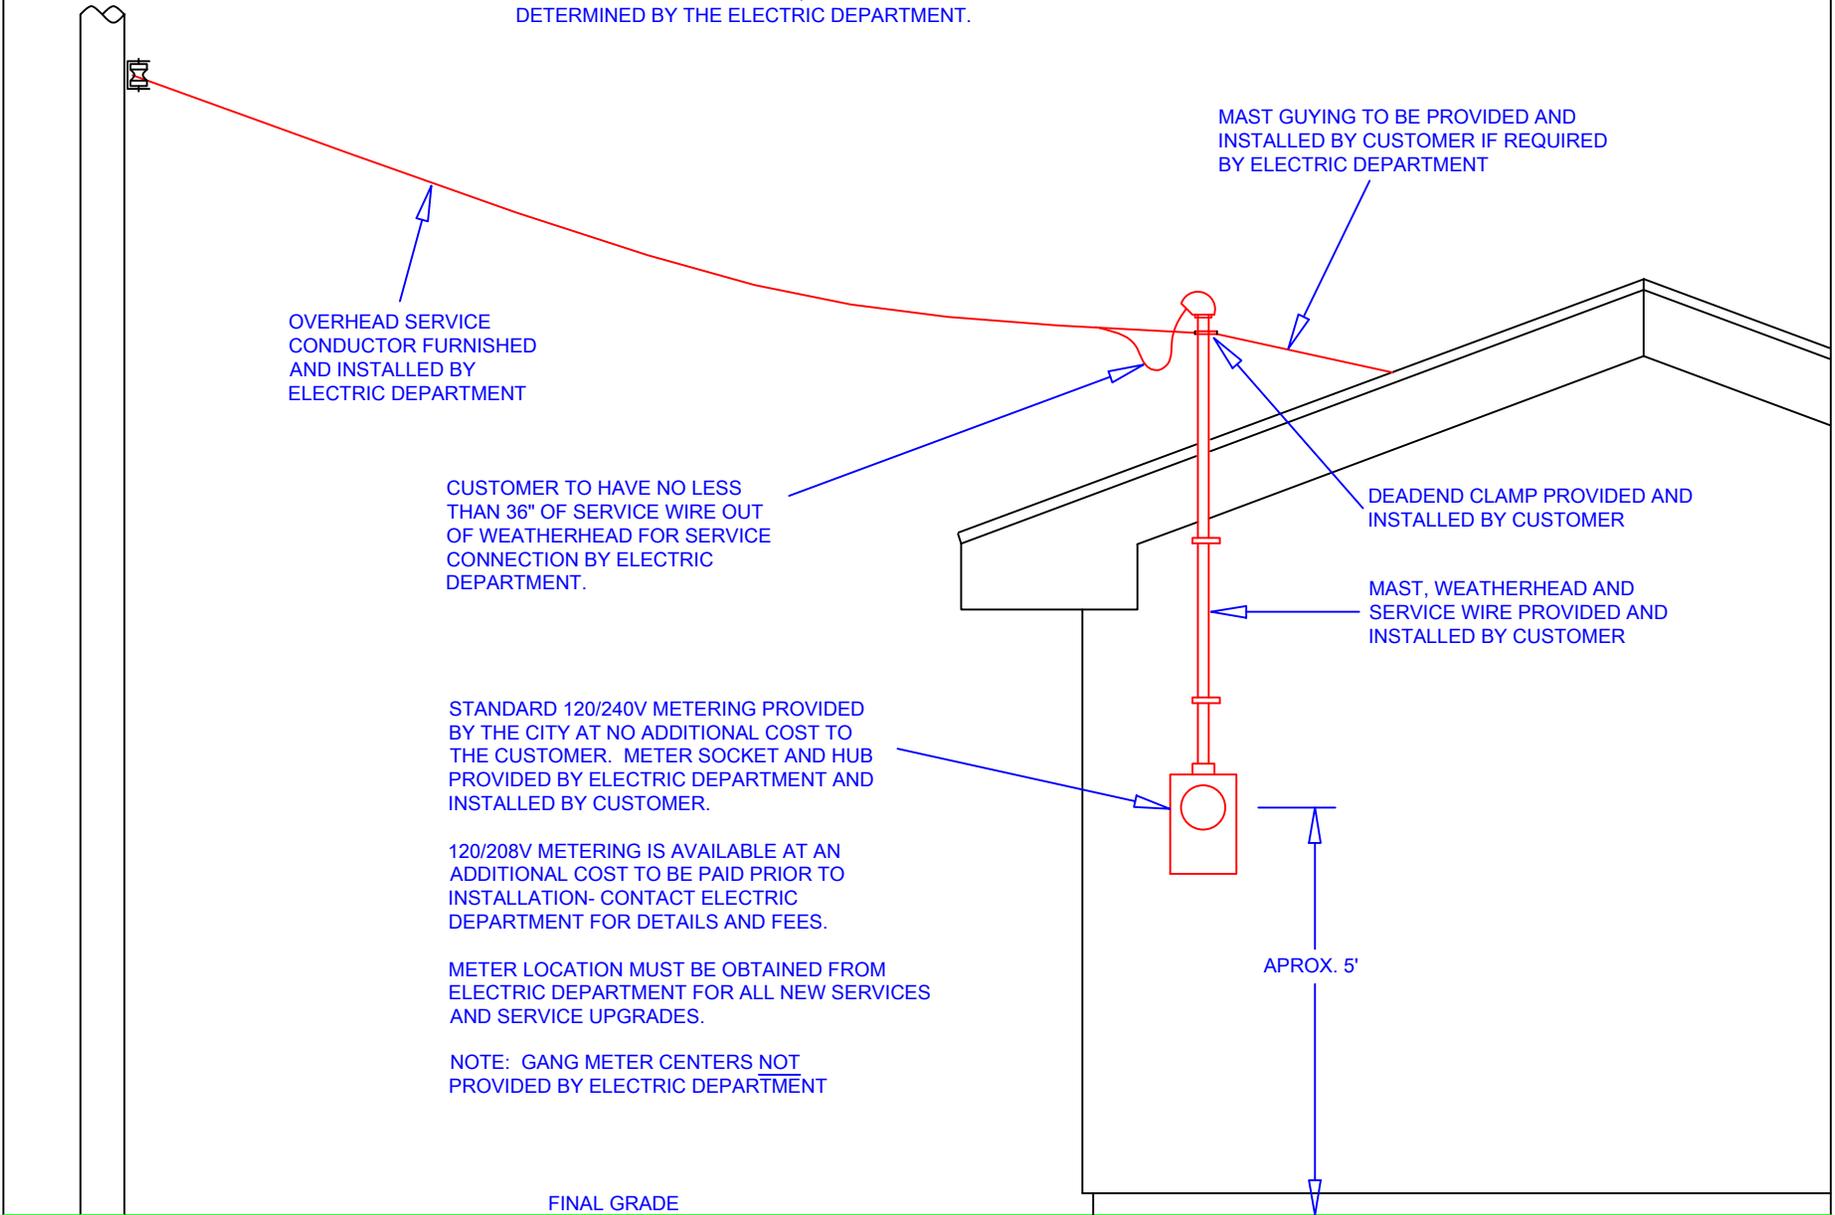

OVERHEAD SERVICE CONDUCTOR FURNISHED AND INSTALLED BY ELECTRIC DEPARTMENT

MAST GUYING TO BE PROVIDED AND INSTALLED BY CUSTOMER IF REQUIRED BY ELECTRIC DEPARTMENT

CUSTOMER TO HAVE NO LESS THAN 36" OF SERVICE WIRE OUT OF WEATHERHEAD FOR SERVICE CONNECTION BY ELECTRIC DEPARTMENT.

DEADEND CLAMP PROVIDED AND INSTALLED BY CUSTOMER

MAST, WEATHERHEAD AND SERVICE WIRE PROVIDED AND INSTALLED BY CUSTOMER

STANDARD 120/240V METERING PROVIDED BY THE CITY AT NO ADDITIONAL COST TO THE CUSTOMER. METER SOCKET AND HUB PROVIDED BY ELECTRIC DEPARTMENT AND INSTALLED BY CUSTOMER.

120/208V METERING IS AVAILABLE AT AN ADDITIONAL COST TO BE PAID PRIOR TO INSTALLATION- CONTACT ELECTRIC DEPARTMENT FOR DETAILS AND FEES.

METER LOCATION MUST BE OBTAINED FROM ELECTRIC DEPARTMENT FOR ALL NEW SERVICES AND SERVICE UPGRADES.

NOTE: GANG METER CENTERS NOT PROVIDED BY ELECTRIC DEPARTMENT

APROX. 5'

FINAL GRADE

TYPICAL RESIDENTIAL OVERHEAD SERVICE WITH MAST, SINGLE OR GANG METER SOCKET, SINGLE PHASE, MAXIMUM 600 AMP SINGLE SOCKET, ALL GANG SOCKETS

IMPORTANT NUMBERS:
 ELECTRIC DEPARTMENT (540) 375-3030
 BUILDING INSPECTIONS (540) 375-3036
 UTILITY COLLECTIONS (540) 375-3021



City of Salem, VA
 Electric Department
 Service Standards

DRAWING 2 OF 8 REVISED 05/18