


NOTE: THIS INSTALLATION APPLIES TO ALL SINGLE AND MULTI-FAMILY DWELLING STRUCTURES AND ACCESSORY BUILDINGS, INCLUDING GARAGES. MAST HEIGHT REQUIREMENTS TO BE DETERMINED BY THE ELECTRIC DEPARTMENT.

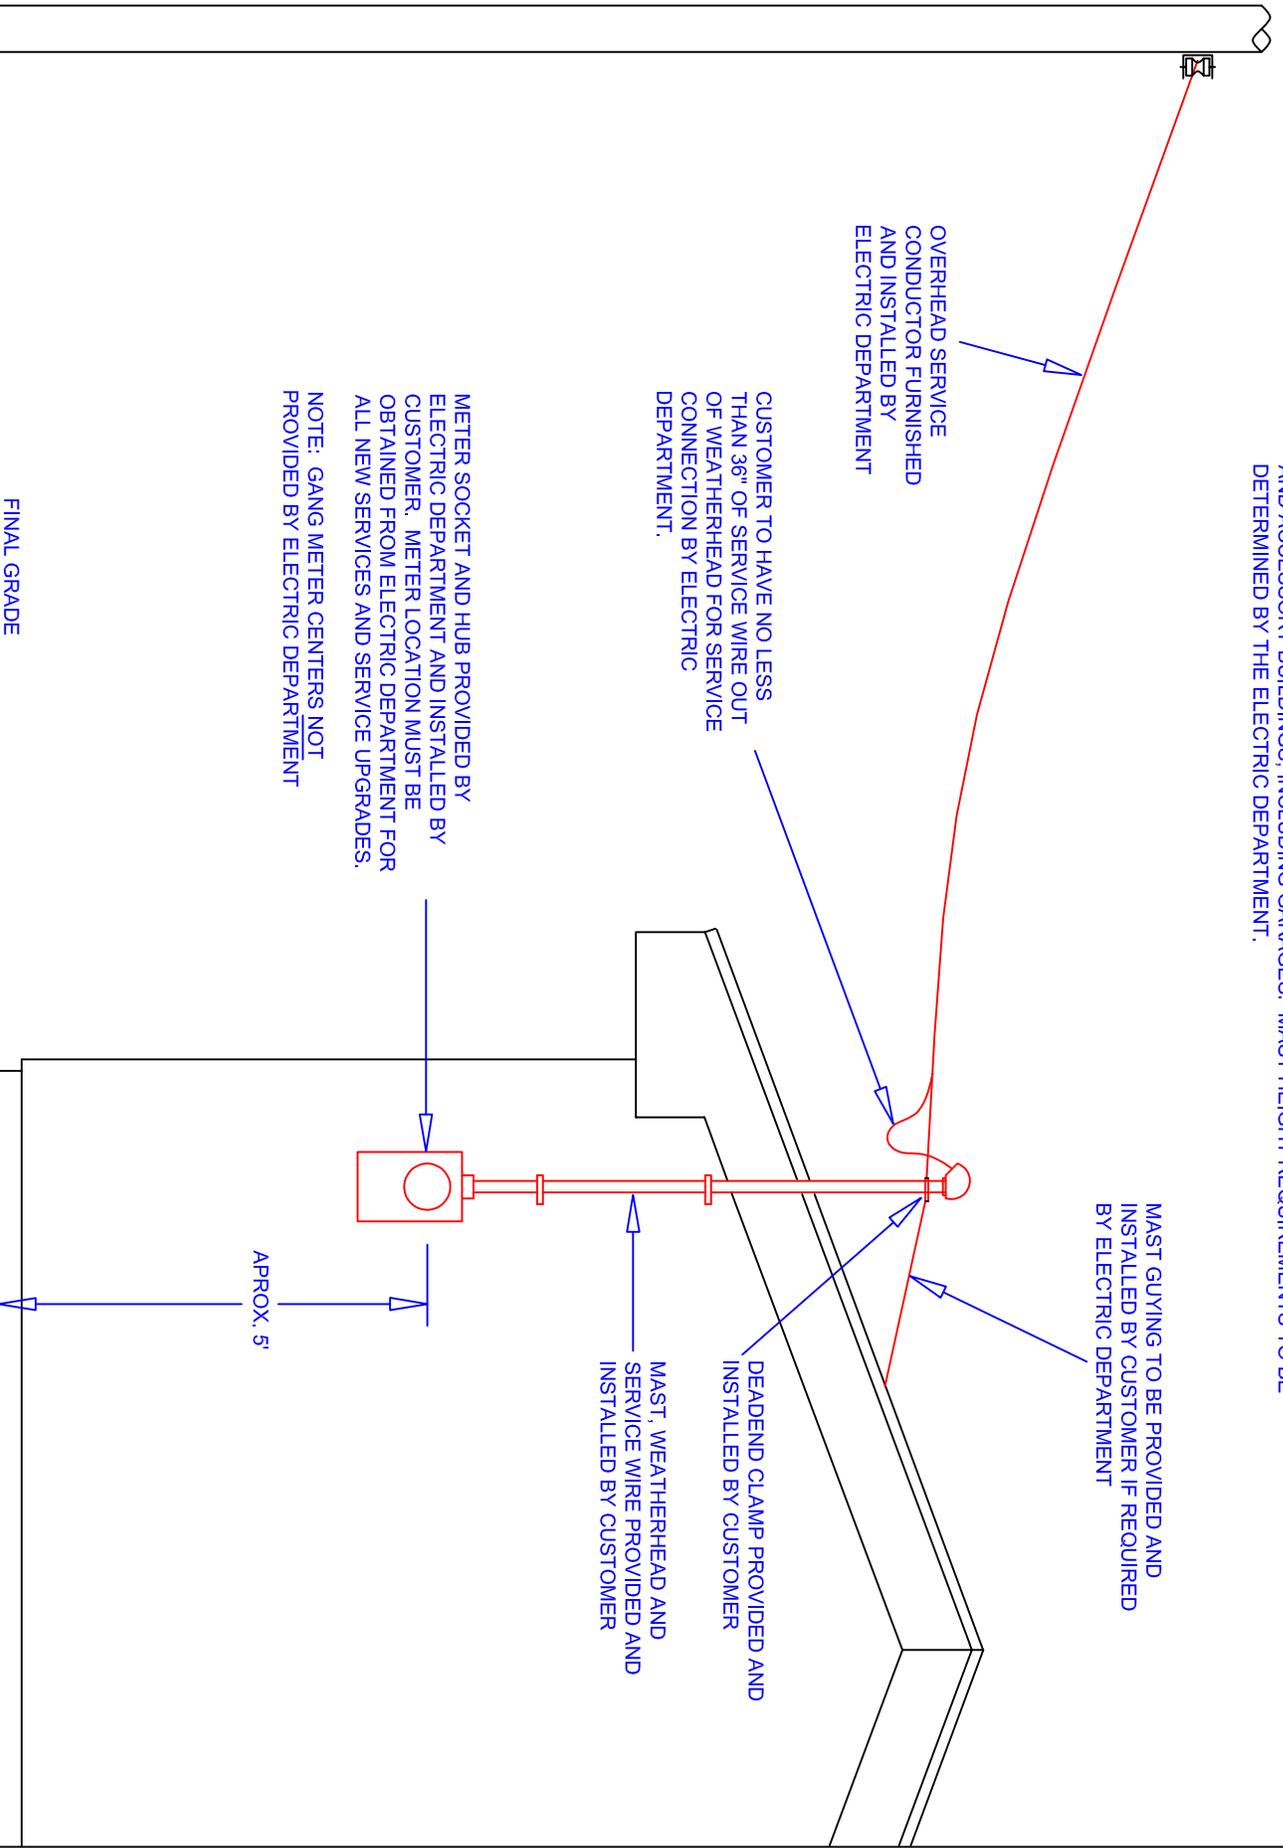

METER SOCKET AND HUB PROVIDED BY ELECTRIC DEPARTMENT AND INSTALLED BY CUSTOMER. METER LOCATION MUST BE OBTAINED FROM ELECTRIC DEPARTMENT FOR ALL NEW SERVICES AND SERVICE UPGRADES.
 NOTE: GANG METER CENTERS NOT PROVIDED BY ELECTRIC DEPARTMENT

MAST GUYING TO BE PROVIDED AND INSTALLED BY CUSTOMER IF REQUIRED BY ELECTRIC DEPARTMENT

DEADEND CLAMP PROVIDED AND INSTALLED BY CUSTOMER

MAST, WEATHERHEAD AND SERVICE WIRE PROVIDED AND INSTALLED BY CUSTOMER

APPROX. 5'

FINAL GRADE

TYPICAL RESIDENTIAL OVERHEAD SERVICE WITH MAST, SINGLE OR GANG METER SOCKET, SINGLE PHASE, MAXIMUM 600 AMP SINGLE SOCKET, ALL GANG SOCKETS

IMPORTANT NUMBERS:

ELECTRIC DEPARTMENT (540) 375-3030
 BUILDING INSPECTIONS (540) 375-3036
 UTILITY COLLECTIONS (540) 375-3021



City of Salem, VA
 Electric Department
 Service Standards
 DRAWING 2 OF 8 REVISED 02/12