


NOTE: THIS INSTALLATION APPLIES TO ALL SINGLE AND MULTIFAMILY DWELLING STRUCTURES AND ACCESSORY BUILDINGS, INCLUDING GARAGES.

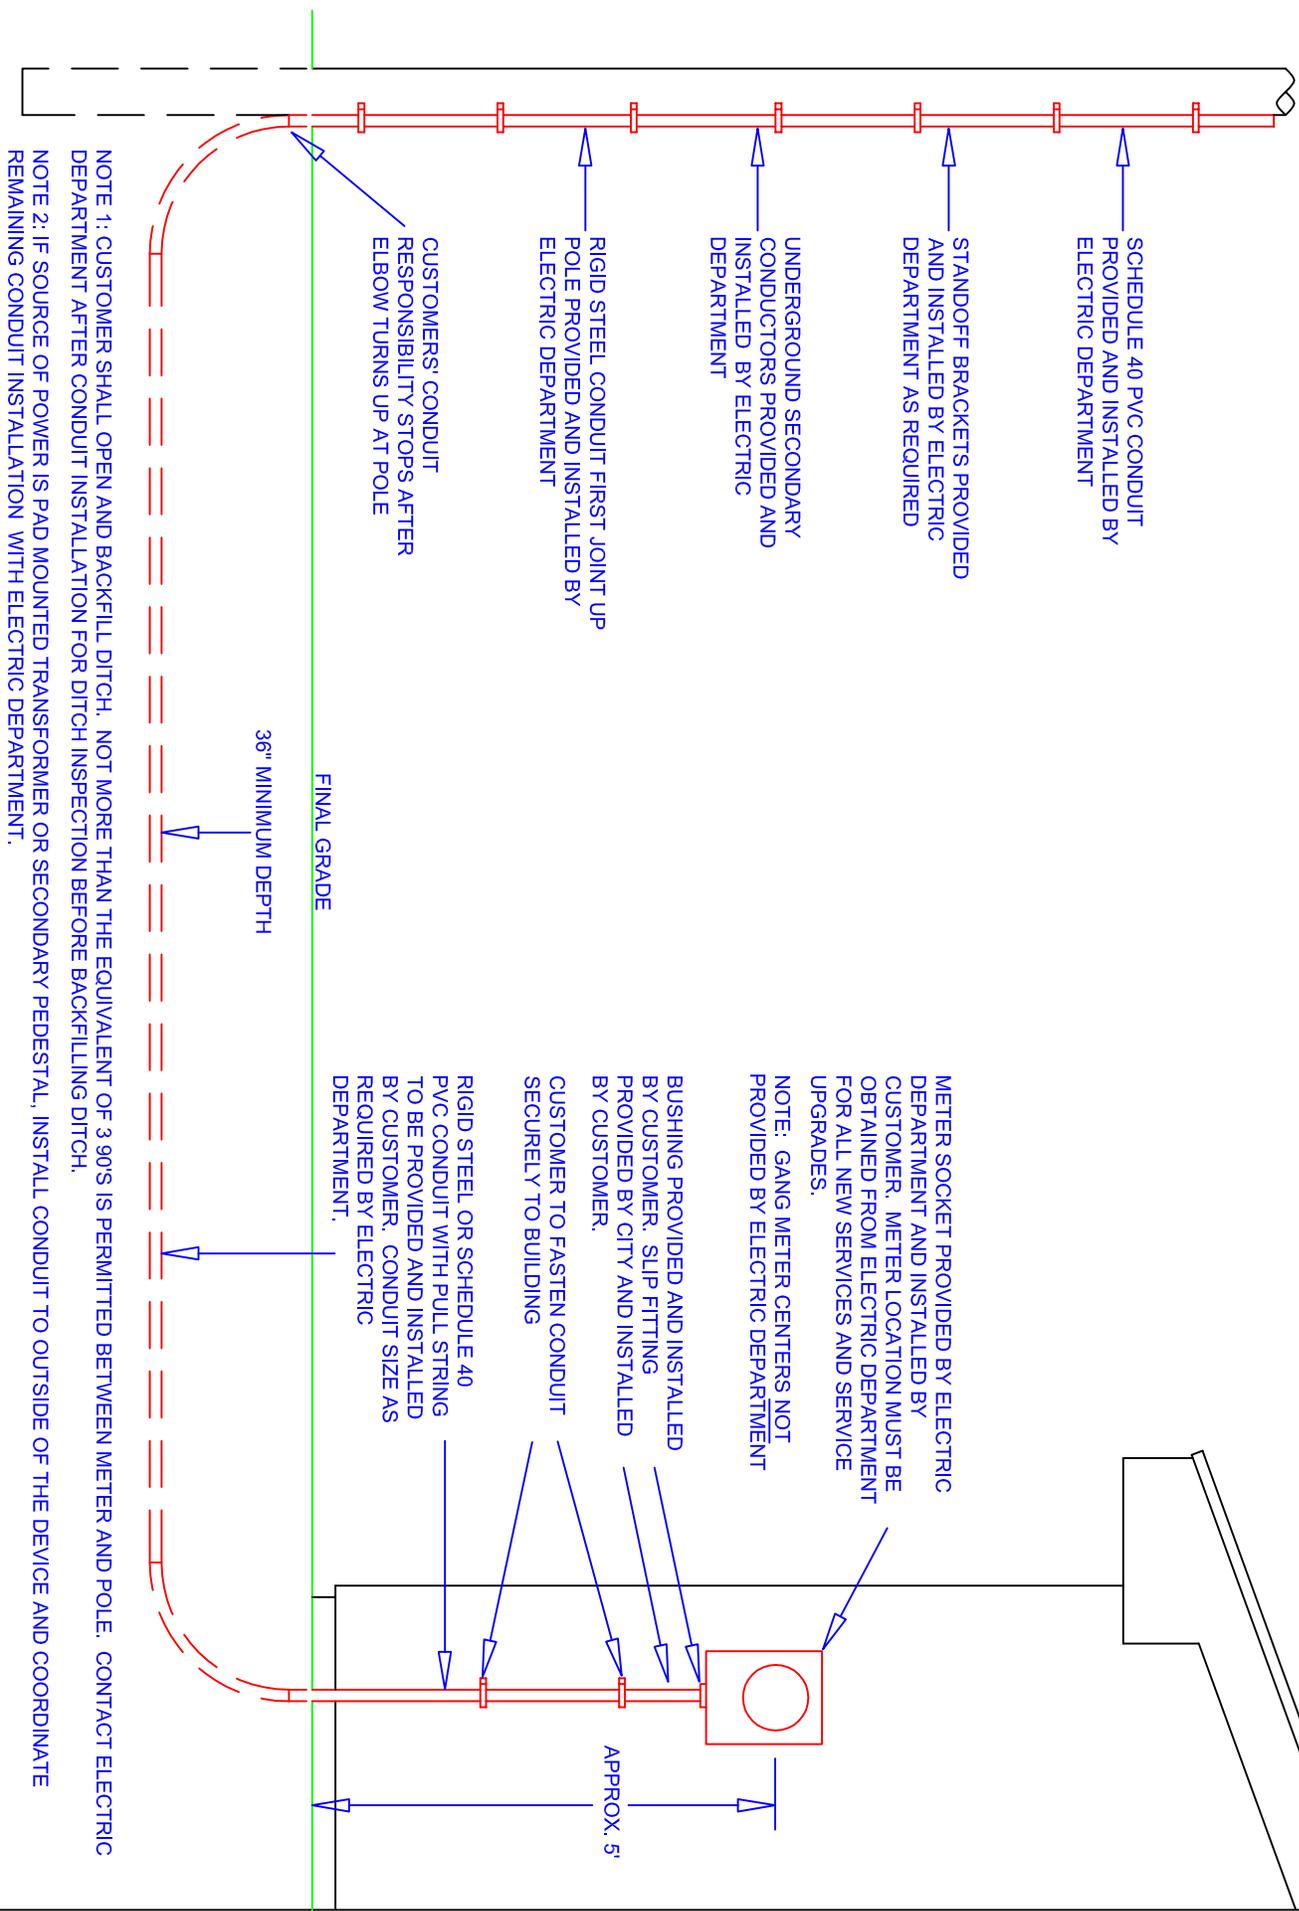

SCHEDULE 40 PVC CONDUIT PROVIDED AND INSTALLED BY ELECTRIC DEPARTMENT

STANDOFF BRACKETS PROVIDED AND INSTALLED BY ELECTRIC DEPARTMENT AS REQUIRED

UNDERGROUND SECONDARY CONDUCTORS PROVIDED AND INSTALLED BY ELECTRIC DEPARTMENT

RIGID STEEL CONDUIT FIRST JOINT UP POLE PROVIDED AND INSTALLED BY ELECTRIC DEPARTMENT

CUSTOMERS' CONDUIT RESPONSIBILITY STOPS AFTER ELBOW TURNS UP AT POLE

36" MINIMUM DEPTH

FINAL GRADE

METER SOCKET PROVIDED BY ELECTRIC DEPARTMENT AND INSTALLED BY CUSTOMER. METER LOCATION MUST BE OBTAINED FROM ELECTRIC DEPARTMENT FOR ALL NEW SERVICES AND SERVICE UPGRADES.

NOTE: GANG METER CENTERS NOT PROVIDED BY ELECTRIC DEPARTMENT

BUSHING PROVIDED AND INSTALLED BY CUSTOMER. SLIP FITTING PROVIDED BY CITY AND INSTALLED BY CUSTOMER.

CUSTOMER TO FASTEN CONDUIT SECURELY TO BUILDING

RIGID STEEL OR SCHEDULE 40 PVC CONDUIT WITH PULL STRING TO BE PROVIDED AND INSTALLED BY CUSTOMER. CONDUIT SIZE AS REQUIRED BY ELECTRIC DEPARTMENT.

APPROX. 5'

NOTE 1: CUSTOMER SHALL OPEN AND BACKFILL DITCH. NOT MORE THAN THE EQUIVALENT OF 3 90'S IS PERMITTED BETWEEN METER AND POLE. CONTACT ELECTRIC DEPARTMENT AFTER CONDUIT INSTALLATION FOR DITCH INSPECTION BEFORE BACKFILLING DITCH.
 NOTE 2: IF SOURCE OF POWER IS PAD MOUNTED TRANSFORMER OR SECONDARY PEDESTAL, INSTALL CONDUIT TO OUTSIDE OF THE DEVICE AND COORDINATE REMAINING CONDUIT INSTALLATION WITH ELECTRIC DEPARTMENT.

TYPICAL RESIDENTIAL UNDERGROUND SERVICE, SINGLE OR GANG METER SOCKET, SINGLE PHASE, MAXIMUM 600 AMP SINGLE SOCKET, ALL GANG SOCKETS

IMPORTANT NUMBERS:

ELECTRIC DEPARTMENT (540) 375-3030
 BUILDING INSPECTIONS (540) 375-3036
 UTILITY COLLECTIONS (540) 375-3021



City of Salem, VA
 Electric Department
 Service Standards
 DRAWING 3 OF 8 REV/SED 02/12